

Features

- 1-channel isolated barrier
- 24 V DC supply (bus powered)
- Input for 2-wire SMART transmitters and current sources
- Output for 4 mA ... 20 mA or 1 V ... 5 V
- Low power dissipation
- Up to SIL 2 acc. to IEC 61508


Function

This isolated barrier is used for intrinsic safety applications. The device supplies 2-wire transmitters in the hazardous area, and can also be used with current sources. It transfers the analog input signal to the safe area as an isolated current value. Bi-directional communication is supported for SMART transmitters that use current modulation to transmit data and voltage modulation to receive data. The output is selected as a current source, current sink, or voltage source via DIP switches. This device mounts on a HiC Termination Board.


Application

- The device supports the following SMART protocols:
- HART
 - BRAIN

Assembly

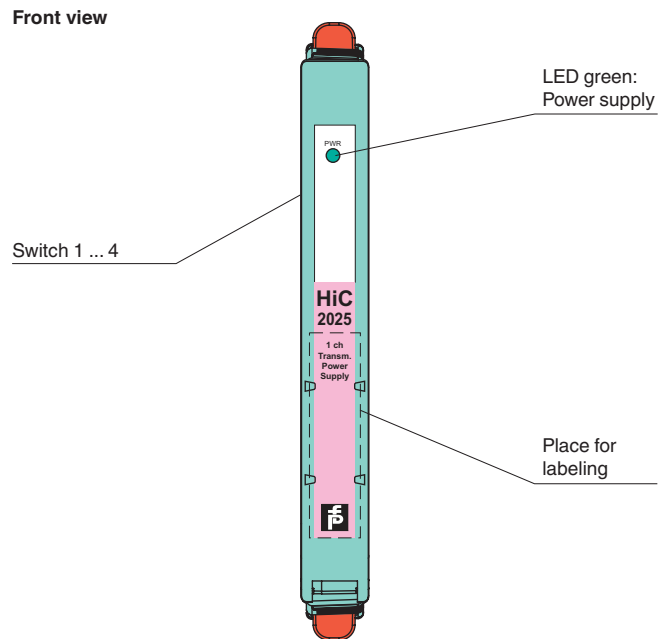

Connection

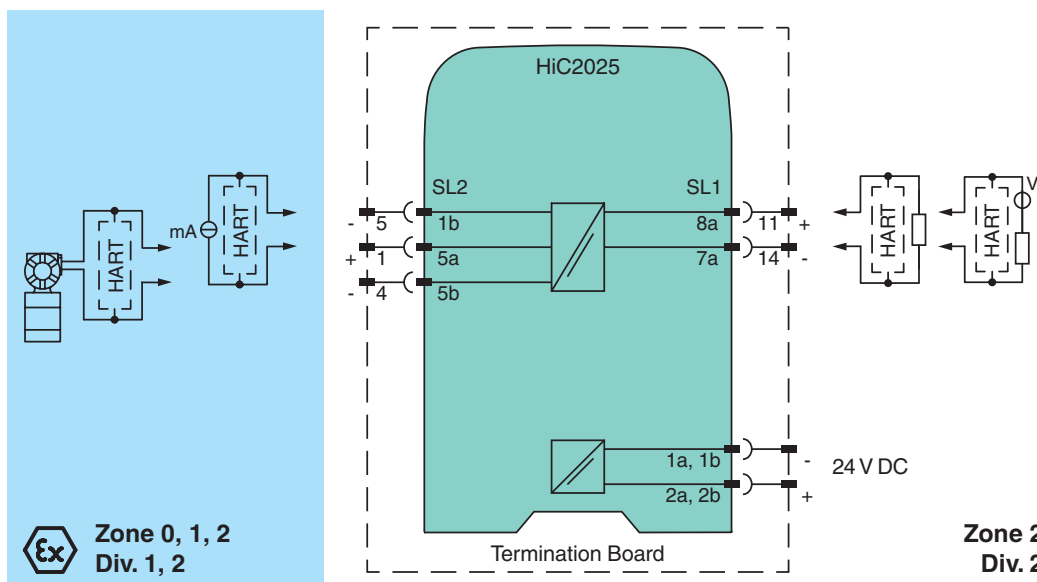

Release date 2016-05-19 08:12 Date of issue 2016-05-19 185539_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".


General specifications		
Signal type		Analog input
Supply		
Connection		SL1: 1a, 1b(-); 2a, 2b(+)
Rated voltage	U_n	19 ... 30 V DC via Termination Board
Ripple		≤ 10 %
Rated current	I_n	≤ 45 mA
Power dissipation		≤ 800 mW
Power consumption		≤ 1.1 W
Input		
Connection		SL2: 5a(+), 1b(-); 5a(+), 5b(-)
Input signal		4 ... 20 mA limited to approx. 30 mA
Voltage drop		approx. 5 V on SL2: 5a(+), 1b(-)
Available voltage		≥ 15 V at 20 mA on SL2: 5a(+), 5b(-)
Output		
Connection		SL1: 8a(+), 7a(-)
Load		0 ... 300 Ω (source mode)
Output signal		4 ... 20 mA or 1 ... 5 V (on 250 Ω, 0.1 % internal shunt) 4 ... 20 mA (sink mode), operating voltage 15 ... 26 V
Ripple		20 mV _{rms}
Transfer characteristics		
Deviation		at 20 °C (68 °F) ≤ ± 0.1 % incl. non-linearity and hysteresis (source mode 4 ... 20 mA) ≤ ± 0.2 % incl. non-linearity and hysteresis (sink mode 4 ... 20 mA) ≤ ± 0.2 % incl. non-linearity and hysteresis (source mode 1 ... 5 V)
Influence of ambient temperature		< 2 μA/K (0 ... 60 °C (32 ... 140 °F)); < 4 μA/K (-20 ... 0 °C (-4 ... 32 °F))
Frequency range		field side into the control side: bandwidth with 0.5 V _{pp} signal 0 ... 3 kHz (-3 dB) control side into the field side: bandwidth with 0.5 V _{pp} signal 0 ... 3 kHz (-3 dB)
Settling time		≤ 200 ms
Rise time/fall time		≤ 20 ms
Electrical isolation		
Input/Output		safe electrical isolation acc. to IEC/EN 60079-11, voltage peak value 375 V
Input/power supply		safe electrical isolation acc. to IEC/EN 60079-11, voltage peak value 375 V
Output/power supply		functional insulation acc. to IEC 62103, rated insulation voltage 50 V _{eff}
Directive conformity		
Electromagnetic compatibility		
Directive 2014/30/EU		EN 61326-1:2013 (industrial locations)
Conformity		
Electromagnetic compatibility		NE 21:2006 For further information see system description.
Degree of protection		IEC 60529:2001
Ambient conditions		
Ambient temperature		-20 ... 60 °C (-4 ... 140 °F)
Mechanical specifications		
Degree of protection		IP20
Mass		approx. 100 g
Dimensions		12.5 x 128 x 106 mm (0.5 x 5.1 x 4.2 in)
Mounting		on Termination Board
Coding		pin 1 and 3 trimmed For further information see system description.
Data for application in connection with Ex-areas		
EC-Type Examination Certificate		CESI 06 ATEX 017
Group, category, type of protection		⊕ II (1)GD [Ex ia] IIC, [Ex iaD] [circuit(s) in zone 0/1/2/20/21/22] ⊕ I (M1) [Ex ia] I
Input		Ex ia, Ex iaD
Supply		
Maximum safe voltage	U_m	250 V AC (Attention! U_m is no rated voltage.)
Equipment		
Equipment		SL2: 5a(+), 5b(-)
Voltage	U_o	25.2 V
Current	I_o	100 mA
Power	P_o	630 mW
Equipment		
Equipment		SL2: 5a(+), 1b(-)
Voltage	U_i	< 30 V
Current	I_i	< 128 mA
Voltage	U_o	7.2 V
Current	I_o	100 mA

Release date 2016-05-19 08:12 Date of issue 2016-05-19 185539_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Power	P _O	25 mW
Statement of conformity		KIWA 15 ATEX 0035 X
Group, category, type of protection, temperature class		Ⓔ II 3G Ex nA IIC T4 Gc
Directive conformity		
Directive 2014/34/EU		EN 60079-0:2012+A11:2013 , EN 60079-11:2012 , EN 60079-15:2010 , EN 50303:2000
International approvals		
FM approval		
Control drawing		16-534FM-12 (cFMus)
IECEX approval		IECEX CES 06.0002
General information		
Supplementary information		EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com.

Configuration

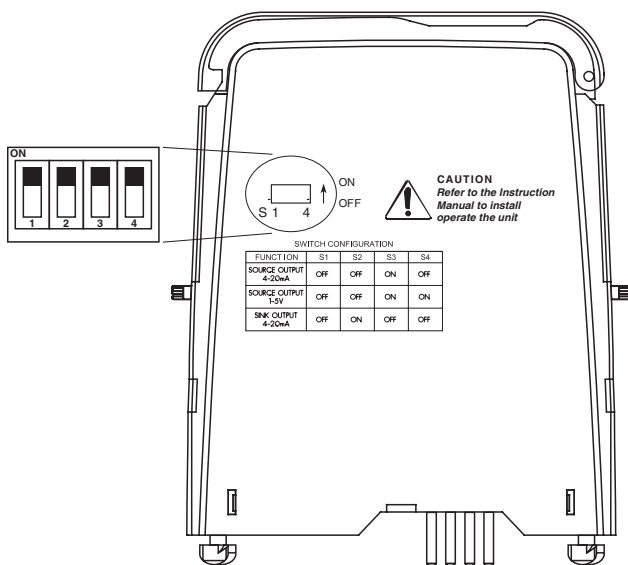

Switch position

Function	S1	S2	S3	S4
Current source 4 mA ... 20 mA	OFF	OFF	ON	OFF
Voltage source 1 V ... 5 V	OFF	OFF	ON	ON
Current sink 4 mA ... 20 mA	OFF	ON	OFF	OFF

Factory settings: current source 4 mA ... 20 mA

Configure the device in the following way:

- Push the red Quick Lok Bars on each side of the device in the upper position.
- Remove the device from Termination Board.
- Set the DIP switches according to the figure.



The pins for this device are trimmed to polarize it according to its safety parameter. Do not change! For further information see system description.