



Circuit-breaker, 4 p, 20A

Part no. **LZMB1-4-A20-I**
Article no. **111868**

Similar to illustration

Delivery programme

Product range				Circuit-breaker
Protective function				System and cable protection
Standard/Approval				IEC
Installation type				Fixed
Release system				Thermomagnetic release
Construction size				LZM1
Description				Set value in neutral conductor is synchronous with set value I_r of main pole.
Number of poles				4 pole
Standard equipment				Box terminal





Switching capacity

400/415 V 50/60 Hz	I_{cu}	kA		25
--------------------	----------	----	--	----

Rated current = rated uninterrupted current

Rated current = rated uninterrupted current	$I_n = I_u$	A		20
Neutral conductor	% of phase conductor	CSA		100


Setting range

Overload trip				
	I_r	A		15 - 20
Main pole	I_r	A		15 - 20
				
Short-circuit releases				
				
Non-delayed	$I_i = I_n \times \dots$			350 A fixed
				

Technical data

General

Standards				IEC/EN 60947, VDE 0660
Protection against direct contact				Finger and back-of-hand proof to VDE 0106 part 100
Climatic proofing				Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27		g		20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140				
Between auxiliary contacts and main contacts		V AC		500
between the auxiliary contacts		V AC		300
Weight		kg		1.33
Mounting position				Vertical and 90° in all directions




With XFI earth-fault release:
- NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit
- NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit:

- NZM3, N3: vertical, 90° left
- NZM4, N4: vertical with remote operator:
- NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions

Direction of incoming supply		as required
Degree of protection		
Device		In the area of the HMI devices: IP20 (basic protection type)
Enclosures		with insulating surround: IP40 with door coupling rotary handle: IP66
Terminations		Tunnel terminal: IP10 Phase isolator and band terminal: IP00

Circuit-breakers

Rated current = rated uninterrupted current	$I_n = I_u$	A	20
Rated surge voltage invariability	U_{imp}		
Main contacts		V	6000
Auxiliary contacts		V	6000
Rated operational voltage	U_e	V AC	440
Overvoltage category/pollution degree			III/3
Rated insulation voltage	U_i	V	690
Use in unearthed supply systems		V	 440

Switching capacity

Rated short-circuit making capacity	I_{cm}		
240 V 50/60 Hz	I_{cm}	kA	63
400/415 V 50/60 Hz	I_{cm}	kA	53
440 V 50/60 Hz	I_{cm}	kA	53
Rated short-circuit breaking capacity I_{cn}	I_{cn}		
I_{cu} to IEC/EN 60947 test cycle 0-t-CO	I_{cu}	kA	
240 V 50/60 Hz	I_{cu}	kA	30
400/415 V 50/60 Hz	I_{cu}	kA	25
440 V 50/60 Hz	I_{cu}	kA	25
I_{cs} to IEC/EN 60947 test cycle 0-t-CO-t-CO	I_{cs}	kA	
230 V 50/60 Hz	I_{cs}	kA	30
400/415 V 50/60 Hz	I_{cs}	kA	25
440 V 50/60 Hz	I_{cs}	kA	18.5
			Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Utilization category to IEC/EN 60947-2			A
Rated making and breaking capacity			
Rated operational current	I_e	A	
AC-1			
380 V 400 V	I_e	A	160
415 V	I_e	A	125
AC--3			
380 V 400 V	I_e	A	20
415 V	I_e	A	20
660 V 690 V	I_e	A	20
Lifespan, mechanical	Operations		20000
Lifespan, electrical			
AC-1			
400 V 50/60 Hz	Operations		7500
415 V 50/60 Hz	Operations		10000
AC-2, AC-3			
415 V 50/60 Hz	Operations		7500
Max. operating frequency		Ops/h	120
Current heat losses per pole at I_u are based on the maximum rated operational current of the frame size.		W	16.7

			For current heat loss per pole the specification refers to the maximum rated operational current of the frame size.																																													
Total downtime in a short-circuit		ms	< 10																																													
Terminal capacity																																																
Standard equipment			Box terminal																																													
Overview			<table border="1"> <tr> <td>Basic equipment</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>Box terminal</td> <td>●</td> <td>-</td> <td>-</td> <td>-</td> </tr> <tr> <td>Screw connection</td> <td>-</td> <td>●</td> <td>●</td> <td>●</td> </tr> <tr> <td>accessory consideration</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>Box terminals</td> <td>-</td> <td>●</td> <td>●</td> <td>-</td> </tr> <tr> <td>Screw connection</td> <td>●</td> <td>-</td> <td>-</td> <td>●</td> </tr> <tr> <td>Tunnel terminal connection on rear Strip terminal</td> <td>●</td> <td>●</td> <td>●</td> <td>●</td> </tr> <tr> <td></td> <td>●</td> <td>●</td> <td>●</td> <td>●</td> </tr> <tr> <td></td> <td>-</td> <td>-</td> <td>-</td> <td>●</td> </tr> </table>	Basic equipment					Box terminal	●	-	-	-	Screw connection	-	●	●	●	accessory consideration					Box terminals	-	●	●	-	Screw connection	●	-	-	●	Tunnel terminal connection on rear Strip terminal	●	●	●	●		●	●	●	●		-	-	-	●
Basic equipment																																																
Box terminal	●	-	-	-																																												
Screw connection	-	●	●	●																																												
accessory consideration																																																
Box terminals	-	●	●	-																																												
Screw connection	●	-	-	●																																												
Tunnel terminal connection on rear Strip terminal	●	●	●	●																																												
	●	●	●	●																																												
	-	-	-	●																																												
Round copper conductor																																																
Box terminal																																																
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)																																													
Stranded		mm ²	1 x (25 - 70) 2 x 25																																													
Tunnel terminal																																																
Solid		mm ²	1 x (16 - 95)																																													
Stranded		mm ²																																														
Stranded		mm ²	1 x (25 - 95)																																													
Bolt terminal and rear-side connection																																																
Direct on the switch																																																
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)																																													
Stranded		mm ²	1 x (25 - 70) 2 x 25																																													
Al conductors, Cu cable																																																
Solid		mm ²	1 x 16																																													
Stranded		mm ²																																														
Stranded		mm ²	1 x (25 - 95)																																													
Cu strip (number of segments x width x segment thickness)																																																
Box terminal																																																
	min.	mm	2 x 9 x 0.8																																													
	max.	mm	9 x 9 x 0.8																																													
Copper busbar (width x thickness)	mm																																															
Bolt terminal and rear-side connection																																																
Screw connection			M8																																													
Direct on the switch																																																
	min.	mm	12 x 5																																													
	max.	mm	16 x 5																																													
Control cables																																																
		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)																																													

Design verification as per IEC/EN 61439


Technical data for design verification			
Rated operational current for specified heat dissipation	I _n	A	20
Equipment heat dissipation, current-dependent	P _{vid}	W	9.816
IEC/EN 61439 design verification			


10.2 Strength of materials and parts		
10.2.2 Corrosion resistance		Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures		Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat		Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects		Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation		Meets the product standard's requirements.
10.2.5 Lifting		Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact		Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions		Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES		Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances		Meets the product standard's requirements.
10.5 Protection against electric shock		Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components		Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections		Is the panel builder's responsibility.
10.8 Connections for external conductors		Is the panel builder's responsibility.
10.9 Insulation properties		
10.9.2 Power-frequency electric strength		Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage		Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material		Is the panel builder's responsibility.
10.10 Temperature rise		The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating		Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility		Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function		The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

Technical data ETIM 6.0

Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation prot. (EC000228)			
Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss8.1-27-37-04-09 [AJZ716010])			
Rated permanent current I _u	A		20
Rated voltage	V		690 - 690
Rated short-circuit breaking capacity I _{cu} at 400 V, 50 Hz	kA		25
Overload release current setting	A		15 - 20
Adjustment range short-term delayed short-circuit release	A		0 - 0
Adjustment range undelayed short-circuit release	A		350 - 350
Integrated earth fault protection			No
Type of electrical connection of main circuit			Frame clamp
Device construction			Built-in device fixed built-in technique
Suitable for DIN rail (top hat rail) mounting			No
DIN rail (top hat rail) mounting optional			Yes
Number of auxiliary contacts as normally closed contact			0
Number of auxiliary contacts as normally open contact			0
Number of auxiliary contacts as change-over contact			0
Switched-off indicator available			No
With under voltage release			No
Number of poles			4
Position of connection for main current circuit			Front side
Type of control element			Rocker lever
Complete device with protection unit			Yes
Motor drive integrated			No
Motor drive optional			No
Degree of protection (IP)			IP20

Characteristics

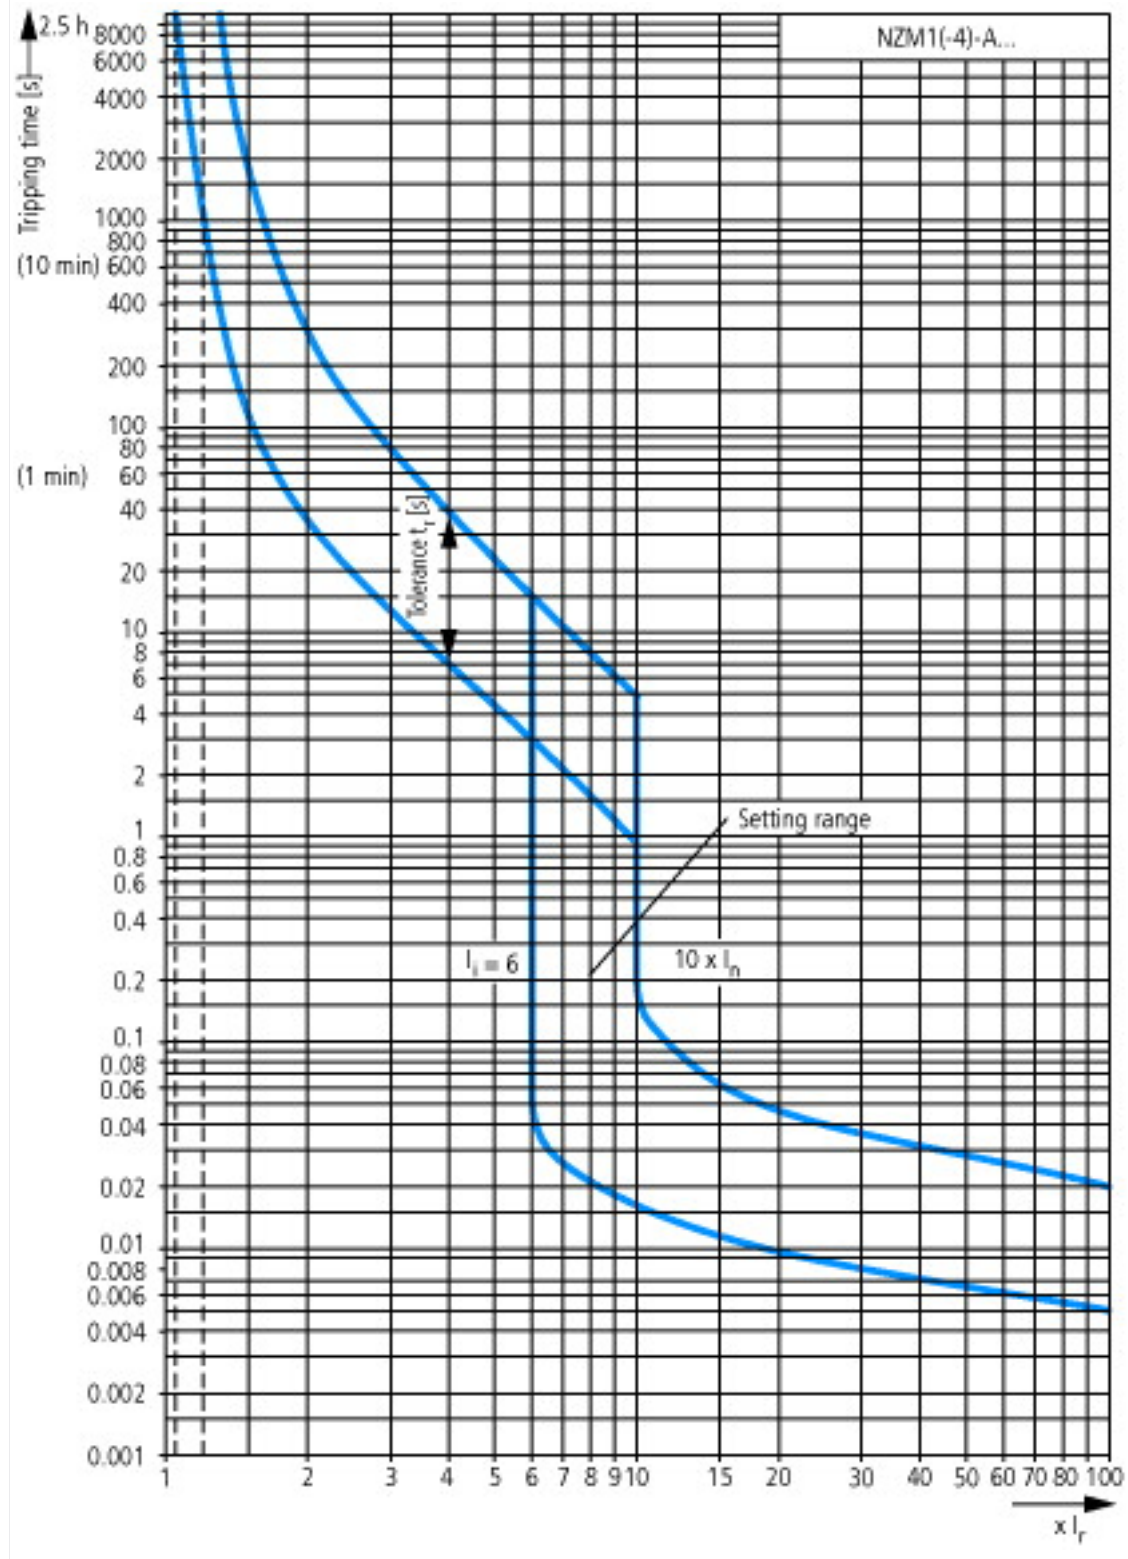

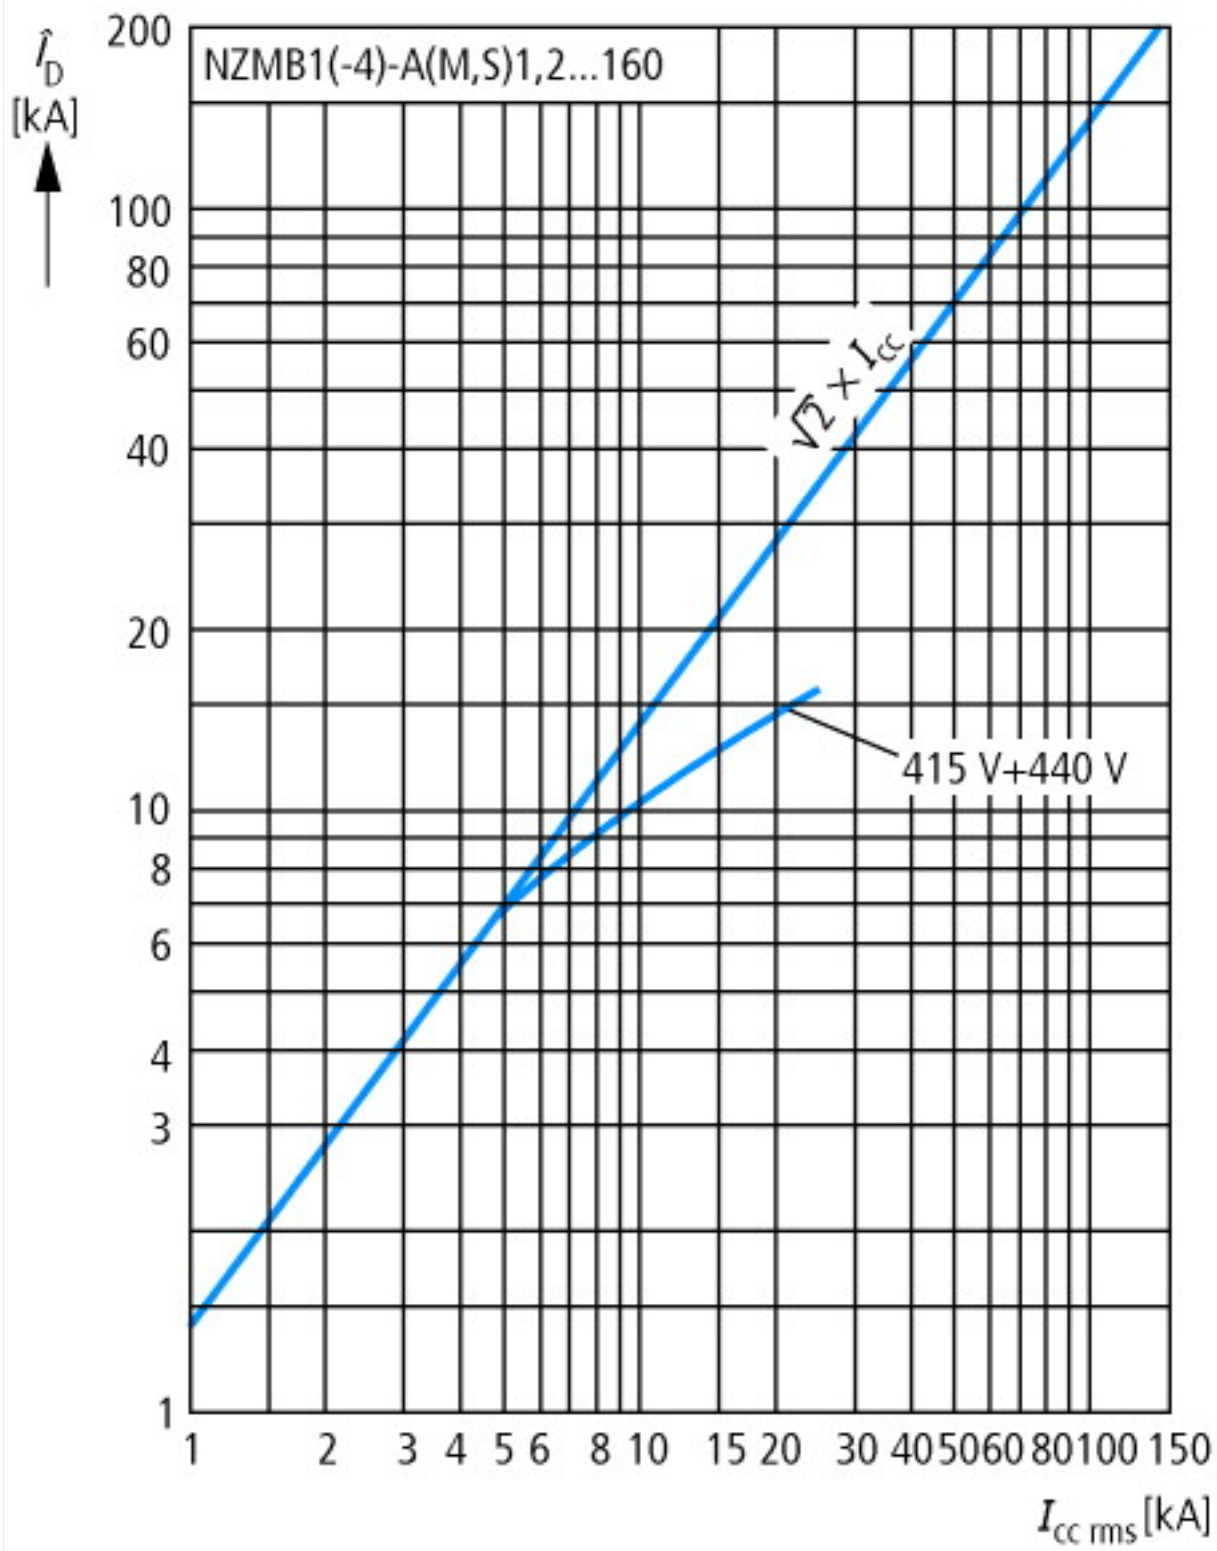



Dimensions



① Blow out area, minimum clearance to other parts



Additional product information (links)

IL01203007Z circuit-breaker LZM.1(-4), switch-disconnector LN1

IL01203007Z circuit-breaker LZM.1(-4), switch-disconnector LN1 ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01203007Z2011_01.pdf